


Chloride Concentrations Well 17B

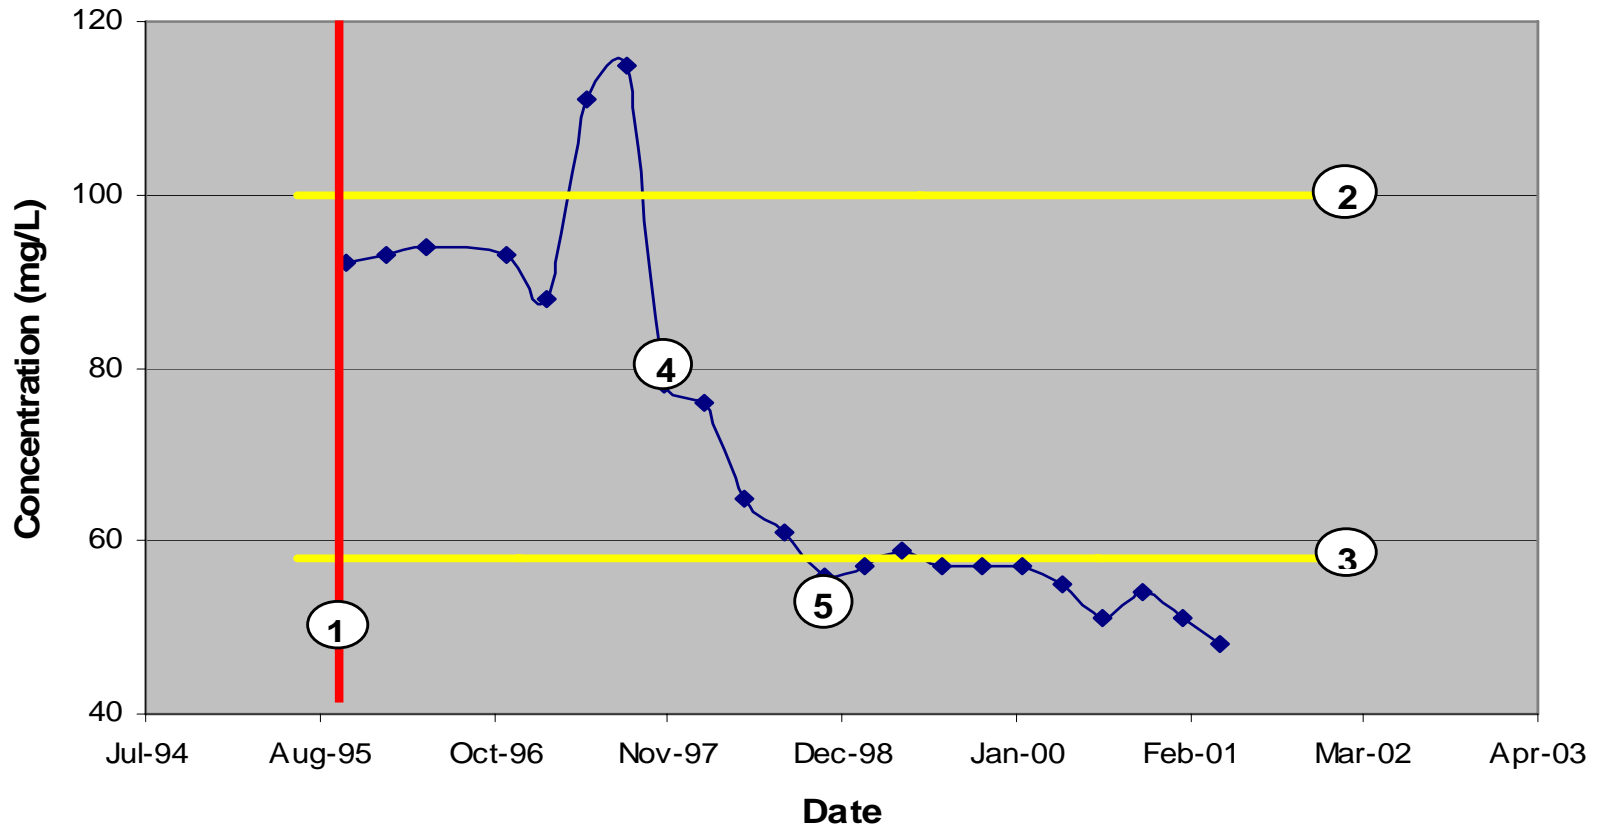

- ① Start of Blended Recycled Water Injection
- ② Historical Chloride Concentration Prior to Injection of Recycled Water (100 mg/L)
- ③ Average Chloride Concentration of Blended Recycled Water (~40%, 60 mg/L)
- ④ "Breakthrough" or 50% RWC of Recycled Water (~2 Years)
- ⑤ 100% RWC (~2.75 Years)